REFER SEPARATE DRAWING FOR CONVENTION CENTER

ON HOLD

REFER SEPARATE DRAWING FOR TOILET

REFER SEPARATE DRAWING

NO. OF CARS: 304 (INCL.4 No.OF. DA.)

BASEMENT 1 PLAN
SCALE _ 1:300

NORTH:

LEGEND:
- RC WALL / COLUMN
- 300mm THK BLOCK WORK
- SLOPE
- GRID LINE
- FIRE COMPARTMENT
- WATER CURTAIN

ABBREVIATION:
- FFL - FINISHED FLOOR LEVEL
- FRL - FORMED ROAD LEVEL
- FPL - FORMED PAVEMENT LEVEL
- FHC - FIRE HOSE CABINET
- LVL - LEVEL
- ELEC.- ELECTRICAL
- ELV - EXTRA LOW VOLTAGE
- AHU - AIR HANDLING UNIT
- PHE - PUBLIC HEALTH ENGINEERING
- TOC - TOP OF CONCRETE LEVEL
- DWP - DRINKING WATER FOUNTAIN
- JAN. - JANITOR'S AREA
- SWP - SEWAGE WASTE PIT
- H.C - HVAC CUT OUT 800 x 800
- SL - SLEEVES FOR DOWN TAKE PIPES
- E.C.1 - ELECTRICAL CUTOUT(600X700)
- E.C.2 - ELECTRICAL CUTOUT(1900X1200)

NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETERS, LEVELS IN METERS AND ANGLES IN DEGREES UNLESS OTHERWISE NOTED.
2. THE DRAWING IS TO BE READ AND NOT TO BE SCALED; ONLY WRITTEN DIMENSIONS IN ALL CASES SHALL BE FOLLOWED.
3. THE DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL, STRUCTURAL, AND SERVICE DRAWINGS.
4. ALL DIMENSIONS SHALL BE VERIFIED ON SITE PRIOR TO START OF WORK AND ANY DISCREPANCY SHALL BE BROUGHT TO THE NOTICE OF THE ARCHITECT.
5. TYPICAL ±0.00 LVL. CORRESPONDENCE TO +213.88M
6. ALL VENTILATION CUTOUT IN RETAINING WALL TO BE CO-ORDINATED WITH STRUCTURE DRAWING.
7. FEA CUTOUT 300MM X 300MM.
8. REFER SEPARATE DRAWING FOR ALL MASONRY WALL / DRY WALL PARTITION CUTOUTS
9. FOR ALL F.A.C & SERVICES REFER DETAIL SERVICES DRAWING.
11. FLOORING DROP AT DOOR ENTRIES TO BE BLENDED IN SLOPE

S. NO.	TAG NO.	ROOM NAME	X(M)	Y(M)	AREA
1	B1000	STAIRCASE-4	4.99	7.57	37.77
2	B1001	CORE-3	4.50	7.15	32.18
3	B1002	STAIRCASE-4	7.70	4.50	34.65
4	B1003	CORE-9	7.15	4.50	32.18
5	B1004	STAIRCASE-21	4.83	8.79	42.45
6	B1005	CORE-10	4.50	7.75	34.88
7	B1006	CORE-14	7.05	4.60	32.43
8	B1007	CORE-13	7.15	4.50	32.18
9	B1008	CORE-8	7.25	4.50	32.63
10	B1009	CORE-7	7.25	5.87	42.56
11	B1010	CORE-6	7.25	4.50	32.63
12	B1011	STAIRCASE-8	4.00	11.40	45.60
13	B1012	STAIRCASE-15	4.00	11.40	45.60
14	B1013	STAIRCASE-23	12.15	3.92	47.63
15	B1014	LIFT LOBBY	4.80	8.55	40.08
16	B1015	LIFT LOBBY	4.80	8.35	40.08
17	B1016	LIFT LOBBY	7.45	3.87	28.83
18	B1017	CORE-5 CORRIDOR	6.95	3.35	22.83
19	B1018	EVACUATION CORRIDOR	151.70	4.50	682.65
20	B1019	SERVICE GALLERY	138.72	2.40	332.93
21	B1020	EVACUATION CORRIDOR	7.25	4.00	29.00
22	B1021	LIFT LOBBY	7.35	3.87	28.44
23	B1100	EX FAN RM.	7.83	7.60	57.94
24	B1101	FAN ROOM	7.35	7.80	57.33
25	B1102	DRIVER'S LOUNGE	7.35	15.80	116.13
26	B1103	STR RM	5.25	4.60	24.15
27	B1104	FAN SUPPLY ZONE	5.25	15.80	82.95
28	B1105	EXHAUST FAN ZONE	7.20	7.70	55.44
29	B1106	EXHAUST FAN ZONE	6.01	8.35	50.18
30	B1107	SERVICE SHAFT	4.95	9.62	47.62
31	B1108	FAN SUPPLY ZONE	5.25	16.20	85.05
32	B1109	HRW ROOM	7.35	7.57	55.64
33	B1110	FAN SUPPLY ZONE	5.25	12	63.00
34	B1111	EVACUATION CORRIDOR	7.35	3.82	28.08
35	B1112	EXHAUST FAN ZONE	7.55	7.97	60.17
36	B1113	DRIVER'S TOILET	7.20	4.80	34.56
37	B1114	DRIVER'S ROOM	8.57	4.32	36.17
38	B1115	AHU ROOM	8.10	8.34	67.55
39	B1116	AHU ROOM	4.95	8.34	41.28
40	B1117	UPS ROOM 2	6.35	8.34	52.96
41	B1118	BATTERY ROOM 2	5.00	8.34	41.70
42	B1119	ELECTRICAL ROOM	6.90	8.34	57.55
43	B1120	GUARD ROOM	2.77	1.70	4.71
44	B1121	PUMP ROOM	15.12	12.35	184.14
45	B1122	AHU	3.88	7.40	28.71
46	B1123	UPS ROOM	8.00	7.40	59.20
47	B1124	HVAC PUMP ROOM	11.90	23.87	284.05
48	B1125	HT PANEL ROOM	7.75	6.50	50.38
49	B1126	LT PANEL ROOM	6.02	3.40	20.47
50	B1126	LT PANEL ROOM	5.88	23.40	137.59
51	B1127	AHU ROOM	10.60	9.60	101.76
52	B1128	AHU ROOM	10.60	9.60	101.76
53	B1129	ELECTRICAL ROOM	8.10	9.60	77.76
54	B1130	AHU ROOM	10.60	8.35	88.51
55	B1131	ELECTRICAL ROOM	8.10	9.60	77.76
56	B1132	AHU ROOM	10.60	9.60	101.76
57	B1133	LT PANEL ROOM	26.10	8.10	211.41
58	B1134	TRANSFORMER ROOM	14.08	8.10	114.05
59	B1135	HT PANEL ROOM	14.65	8.10	118.67
60	B1136	TRANSFORMER ROOM	5.82	13.78	80.20
61	B1137	STORAGE/FAN ROOM	5.82	10.96	63.79
62	B1138	PNEUMATIC SYSTEM SCREEN TANK	21.80	7.40	161.32
63	B1139	SERVICES	7.35	32.75	240.71
64	B1140	SERVICES	7.35	23.27	170.82
65	B1141	SERVICES	7.35	7.80	57.33
66	B1142	SERVICES	7.35	15.25	112.09
67	B1143	LCT ROOM	3.00	3.52	10.56
68	B1144	LCT ROOM	3.00	3.52	10.56
69	B1145	STR ROOM	3.00	3.52	10.56
70	B1146	STR ROOM	7.35	4.05	29.72
71	B1147	COMPRESSOR ROOM	7.35	12.06	88.64
72	B1200	STAIRCASE PRESSURISATION SHAFT	2.35	0.85	2.00
73	B1201	SMOKE EXHAUST SHAFT	2.35	6.10	14.34
74	B1202	HRW CUTOUT	1.90	2.00	3.80
75	B1203	ELECTRICAL SHAFT	1.90	1.09	2.07
76	B1204	FRESH AIR SHAFT	1.90	7.70	14.63
77	B1205	FRESH AIR SHAFT	1.90	7.70	14.63
78	B1206	ELECTRICAL SHAFT	4.05	4.00	16.04
79	B1207	STAIRCASE PRESSURISATION	0.85	2.45	2.08
80	B1208	ELECTRICAL SHAFT	0.65	1.80	1.17
81	B1209	TOILET SHAFT	2.05	1.30	2.67
82	B1210	ST. PRESSURISATION SHAFT	1.90	1.00	1.90
83	B1212	FRESH AIR SHAFT	1.90	8.00	15.20
84	B1213	FRESH AIR SHAFT	1.90	8.00	15.20
85	B1214	FRESH AIR SHAFT	1.90	8.00	15.20
86	B1215	LIFT LOBBY PRESSURISATION SHAFT	1.60	2.05	3.28
87	B1216	STAIRCASE PRESSURISATION SHAFT	1.30	2.05	2.67
88	B1217	SMOKE EXHAUST SHAFT	1.79	7.40	13.25
89	B1218	ST. PRESSURISATION SHAFT	0.85	2.35	2.00
90	B1219	SMOKE EXHAUST SHAFT	6.10	2.35	14.34
91	B1220	LIFT LOBBY PRESSURISATION SHAFT	0.68	1.07	0.73
92	B1221	LT.I.B.PRESSURISATION SHAFT	0.68	1.07	0.73
93	B1222	STAIRCASE PRESSURISATION SHAFT	0.68	1.07	0.73
94	B1223	ST. PRESSURISATION SHAFT	0.68	1.07	0.73
95	B1224	FBI OPENING	0.60	1.62	0.97
96	B1225	LT. I.B. PRESSURISATION SHAFT	2.35	0.30	0.71
97	B1226	ELECTRICAL SHAFT	0.40	1.80	0.72
98	B1227	BATTERY ROOM 2	1.80	0.30	0.54
99	B1228	SMOKE EXHAUST	6.10	2.45	14.95
100	B1229	ELECTRICAL SHAFT	2.80	0.6	1.68
101	B1230	1800 MM DEEP PIT ABOVE	2.65	2.55	6.76
102	B1231	1800 MM DEEP PIT ABOVE	2.65	2.35	6.23
103	B1232	ST. PRESSURISATION SHAFT	4.85	1.17	5.67
104	B1233	ST. PRESSURISATION SHAFT	4.85	1.17	5.67
105	B1234	ST. PRESSURISATION SHAFT	4.85	1.17	5.67
106	B1235	PLUMBING SHAFT	7.58	0.90	6.82
107	B1236	PLUMBING SHAFT	11.85	0.87	10.31
108	B1237	ELECTRICAL SHAFT	0.30	1.80	0.54
109	B1238	MEP SHAFT	3.35	3.50	11.73
110	B1239	PLUMBING SHAFT	11.65	0.87	10.14
111	B1240	PLUMBING SHAFT	9.25	0.90	8.33
112	B1241	HVAC CUT OUT	0.80	0.80	0.64
113	B1242	PLUMBING SHAFT	5.03	0.90	4.53
114	B1243	PLUMBING SHAFT	0.7	1.15	0.81
115	B1244	PLUMBING SHAFT	0.70	8.15	5.71
116	B1245	PLUMBING SHAFT	5.05	0.90	4.55
117	B1247	PLUMBING CUTOUT	1.00	1.15	1.15
118	B1248	PLUMBING SHAFT	0.70	8.15	5.71
119	B1249	COVER RETURN AIR	2.50	3.85	9.45
120	B1254	PLUMBING SHAFT	5.15	0.90	4.64
121	B1255	PLUMBING SHAFT	8.04	0.90	7.24
122	B1256	PLUMBING SHAFT	4.85	1.35	6.55
123	B1257	ELECTRICAL SHAFT	1.90	0.85	1.62
124	B1258	HRW CUT OUT	1.90	2.00	3.80
125	B1260	STAIRCASE PRESSURISATION	1.80	3.15	5.67
126	B1261	COVER RETURN AIR	2.50	4.50	11.25
127	B1262	FBI OPENING	1.75	0.60	1.05
128	B1263	ELECTRICAL SHAFT	0.30	1.80	0.54
129	B1264	ELECTRICAL CUTOUT	0.30	0.15	0.05
130	B1266	CEILING CUTOUT	4.80	1.05	5.04
131	B1267	CEILING CUTOUT	5.00	1.00	5.00
132	B1268	ICT SHAFT	1.57	1.17	1.84
133	B1269	ICT SHAFT	1.57	1.17	1.84
134	B1270	ICT SHAFT	1.50	1.17	1.76
135	B1271	FRESH AIR CEILING CUTOUT	5.00	0.60	3.00
136	B1272	PLUMBING SHAFT	0.60	0.85	0.81
137	B1300	FIRE EQUIPMENT AREA - TYPE-1	1.5	0.97	1.46
138	B1301	FIRE EQUIPMENT AREA - TYPE-4	1.95	0.60	1.17
139	B1302	FIRE EQUIPMENT AREA - TYPE-2	1.50	0.75	1.13
140	B1303	FIRE EQUIPMENT AREA - TYPE-1	0.60	1.20	0.72
141	B1304	FIRE EQUIPMENT AREA - TYPE-1	0.60	1.20	0.72
142	B1305	FIRE EQUIPMENT AREA - TYPE-5	0.75	1.50	1.13
143	B1306	FIRE EQUIPMENT AREA - TYPE-1	1.20	0.59	0.71
144	B1307	FIRE EQUIPMENT AREA - TYPE-3	1.79	0.75	1.34
145	B1308	FIRE EQUIPMENT AREA - TYPE-1A	0.60	1.20	0.72
146	B1309	FIRE EQUIPMENT AREA - TYPE-5	1.50	1.98	2.97
147	B1310	FIRE EQUIPMENT AREA - TYPE-5	1.50	0.75	1.13
148	B1311	FIRE EQUIPMENT AREA - TYPE-1A	0.75	2.20	1.65
149	B1312	FIRE EQUIPMENT AREA - TYPE-2	0.75	1.50	1.12
150	B1313	FIRE EQUIPMENT AREA - TYPE-1A	0.60	1.20	0.72
151	B1400	LIFT	2.35	2.65	6.23
152	B1401	LIFT	3.00	2.65	7.95
153	B1402	LIFT	2.65	2.35	6.23
154	B1403	LIFT	2.65	2.35	6.23
155	B1404	LIFT	3.00	2.65	7.95

SERVICE SHAFT LEGEND:-
- ELECTRICAL / LV
- HVAC FRESH AIR
- LIFT LOBBY PRESS
- PLU / FEA / RWP
- HVAC EXHAUST AIR
- STAIRCASE PRESS

Key Plan

India International Convention & Exhibition Centre Limited
Room No. 402A, Ministry of Commerce & Industry, DIPP, Udyog Bhawan, New Delhi - 110011, India

Department of Industrial Policy and Promotion Ministry of Commerce & Industry Government of India

Knowledge Partner
Delhi Mumbai Industrial Corridor Development Corporation
Room No 541 B, 3rd Floor Hotel Ashok, Diplomatic Enclave, 50B Chankyapuri, New Delhi - 110021

Employer Engineer
Programme Management Consultant (PMC)
AECOM

Preliminary Engineering Architecture Consultants (PEAC)
idom — Av. Del Monasterio de El Escorial, 4, 28049 Madrid, Spain
C P KUKREJA — No.D-1, Ashirwad Building, Green Park, New Delhi, Delhi 110016, India

L&T Construction — Buildings & Factories
Mount Poonamallee Road, Manapakkam, P.B.No.979, Chennai – 600 089

Design Consultant
Engineering Design and Research Center (EDRC)
L&T Construction - Buildings & Factories

Architectural Consultant
ARCOP — Arcop Associates Pvt. Ltd., A-15, Pamposh Enclave, G.K.-I, New Delhi, Delhi 110048, India

Structural Proof Consultant
Indian Institute of Technology (IIT) Madras, Sardar Patel Rd, Opposite to C. L.E.I. Adyar, Chennai, Tamil Nadu 600036

MEP Proof Consultant
egis — Egis India Consulting Engineers Pvt. Ltd., Plot No. 66, Sector 32, Institutional Area, Opp: Zenotis Solutions, Gurugram, Haryana 122001

ICT Proof Consultant
CKR — CKR Consulting Engineers Pvt. Ltd., #47/1, 3rd Floor, Narayana Arcade, Subbaramachetty Road, Nellalappa Circle, Basavanagudi, Bengaluru - 560004

Certification

EPC Contractor — Verified
Design Consultant — Verified
Architectural Consultant — Verified
Proof Consultant
Structural — Verified
MEP — Verified
ICT — Verified
PEAC — Reviewed GFC drawing prepared by Contractor and ensured that all preliminary aspects and parameters have been adopted to I.
Issued by: Project on behalf of PEAC — Date: 04-05-24
Employer / Employer's Engineer

R0	ISSUED FOR GFC	30.05.19	VA	AB	VK
REV	DESCRIPTION	DATE	DSGN	DRWN	CHKD	APPD

Revisions

ARCHITECTURE		FPS		
STRUCTURAL		PHE		
ELECTRICAL		GEOTECH		
ELV SYSTEM				
HVAC				
CHECKED BY	SGN	DATE	CHECKED BY	SGN	DATE

EPC Contractor
L&T Construction — Buildings & Factories

JOB No : 017203

Project Name
DESIGN AND CONSTRUCTION OF INDIA INTERNATIONAL CONVENTION & EXPO CENTRE
SECTOR 25, DWARKA, NEW DELHI, INDIA

Drawing Status: GOOD FOR CONSTRUCTION
GOOD FOR CONSTRUCTION

Drawing No			Rev. No
A	01	0003	R0

Title :
EXHIBITION HALL 1
FOYER BASEMENT 1 FLOOR PLAN
(-4.5M LVL)

EDRC DWG No :	Scale	Sheet Size
O17203-A-SP-01-WD-0003	1:300	A0

This drawing is the property of L&T Construction. E&R EDRC and it should not be passed on to any person or body not authorised by us to receive it nor be copied or otherwise made use either in full or in part by such person or body without our prior permission in writing.

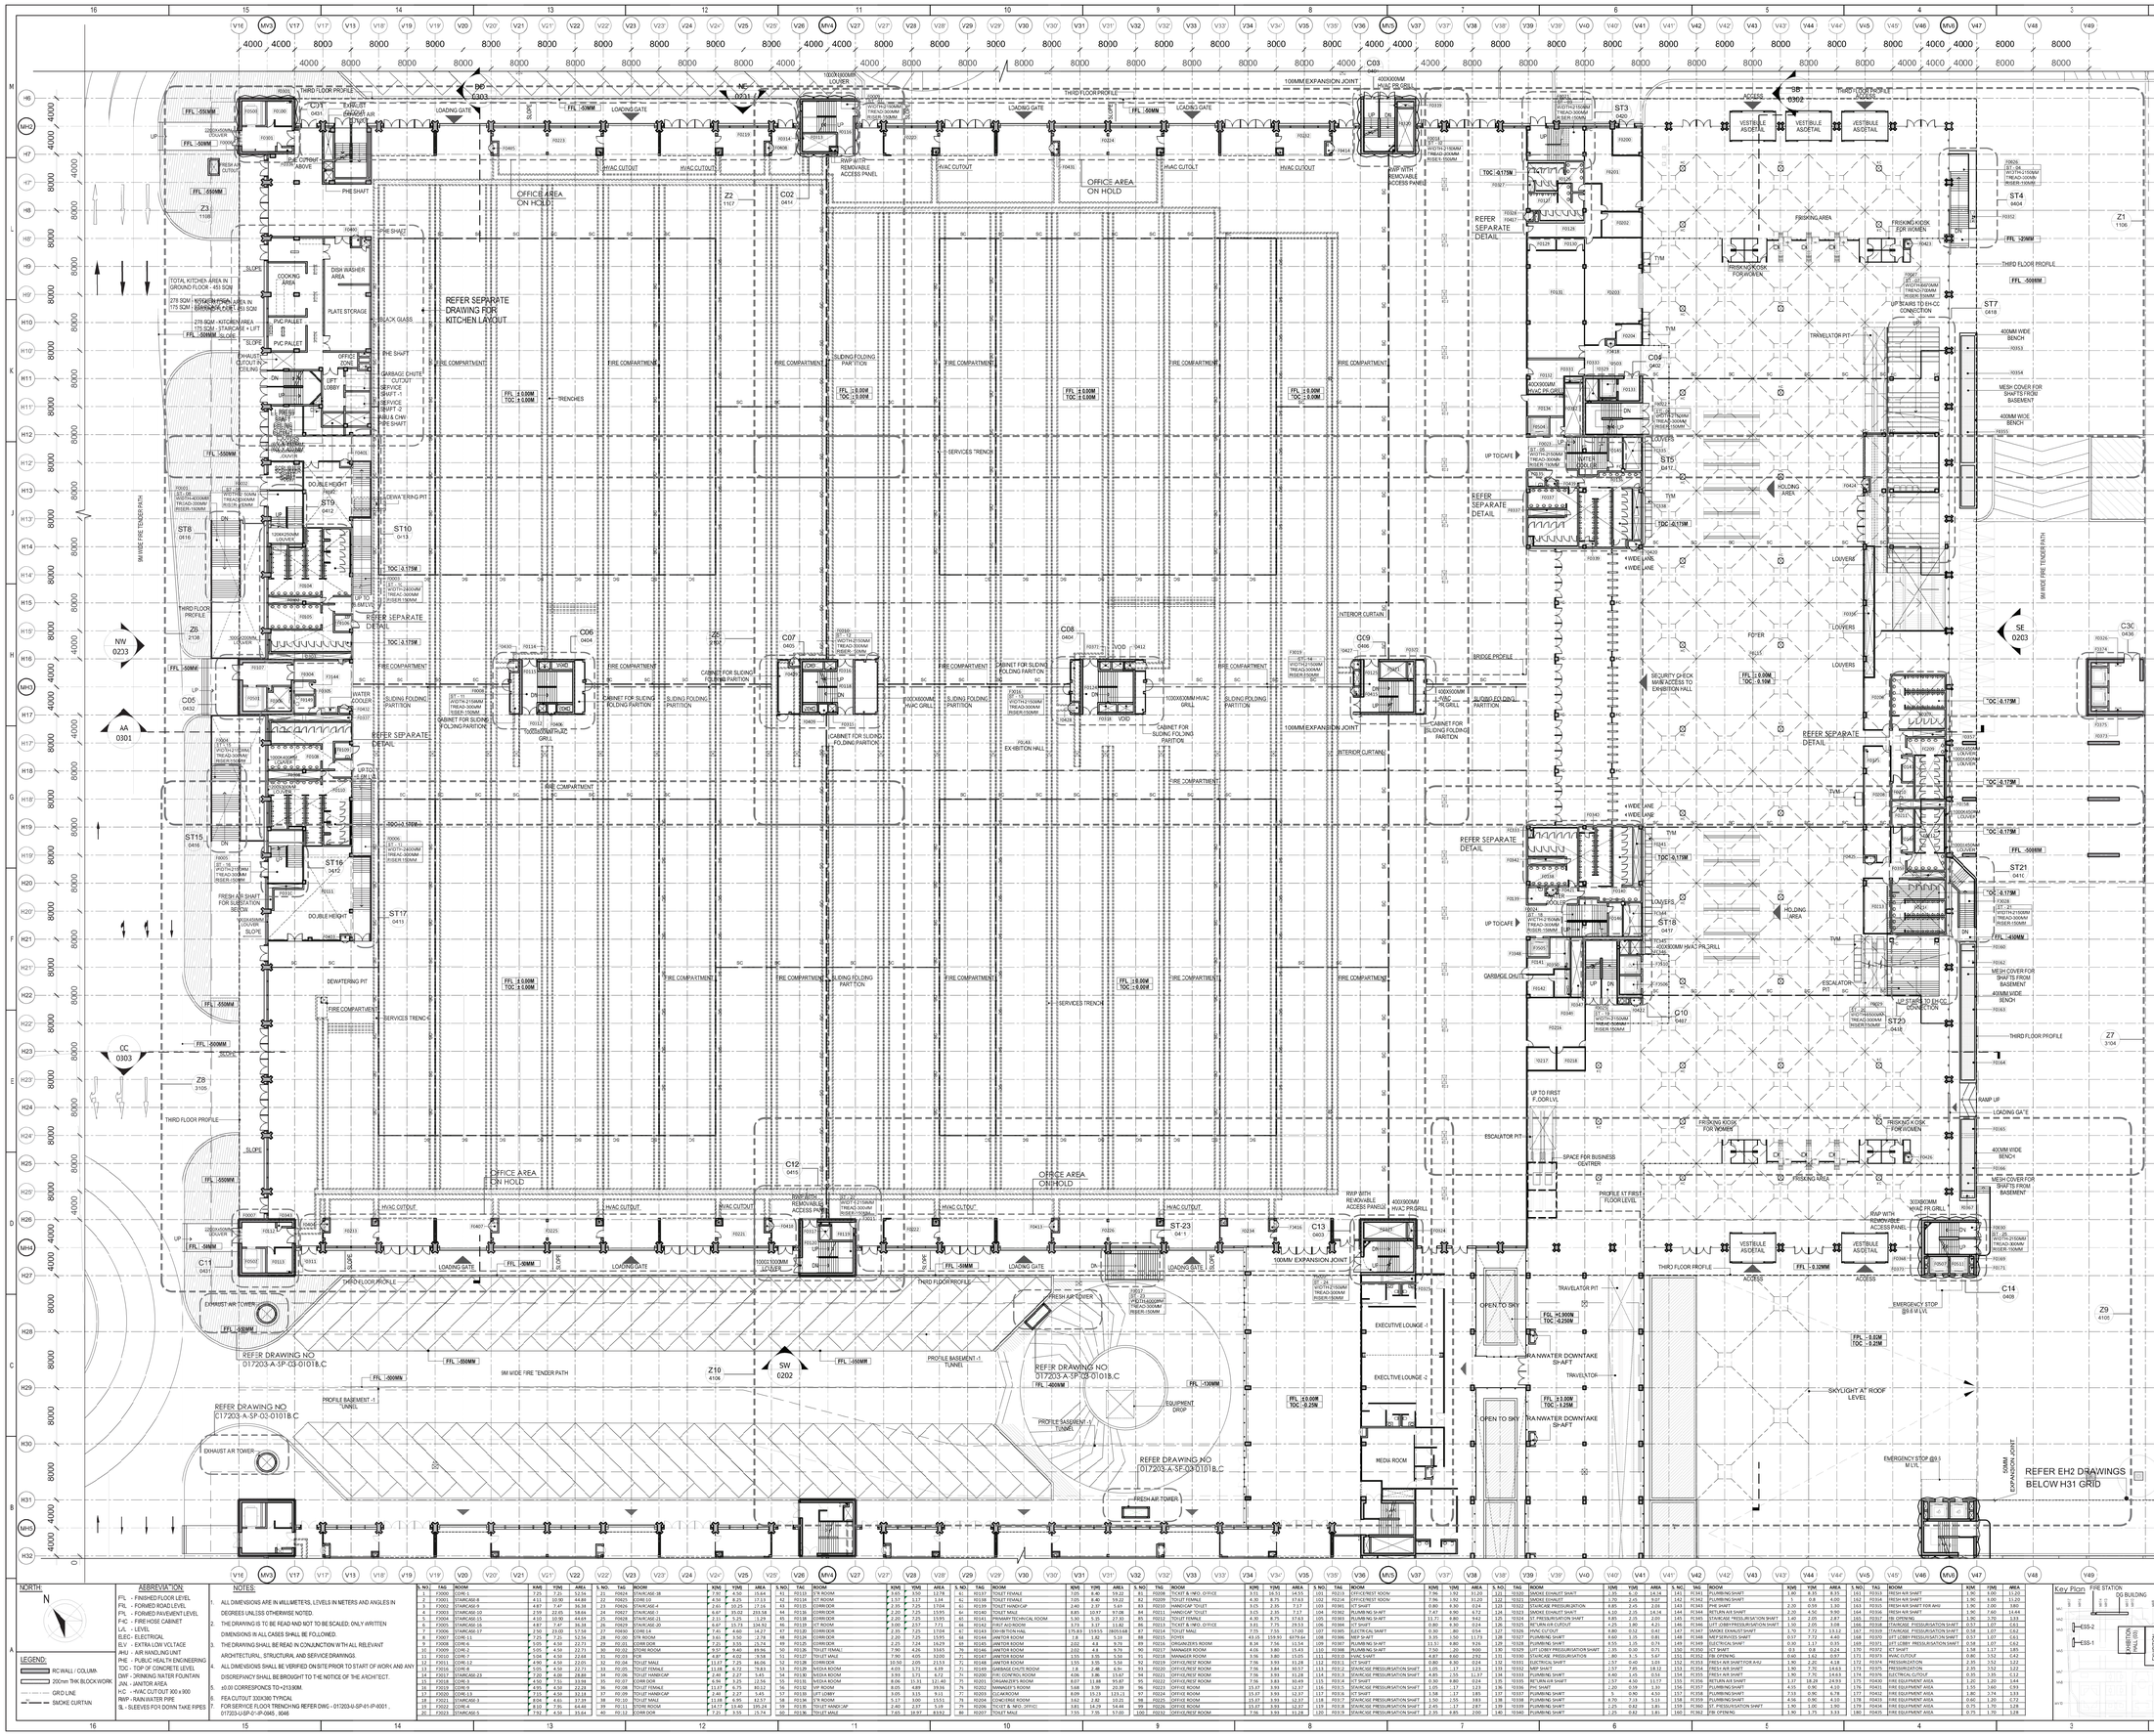
REFER SEPARATE DRAWING FOR KITCHEN LAYOUT
OFFICE AREA ON HOLD
OFFICE AREA ON HOLD
OFFICE AREA ON HOLD
TOTAL KITCHEN AREA IN GROUND FLOOR - 455 SQM
278 SQM - KITCHEN AREA IN 175 SQM - STAIRCASE & LIFT SLOPE
278 SQM - KITCHEN AREA
175 SQM - STAIRCASE + LIFT SLOPE
REFER SEPARATE DETAIL
REFER DRAWING NO C17203-A-SP-03-0101B.C
REFER DRAWING NO C17203-A-SP-03-0101B.C
REFER DRAWING NO C17203-A-SP-03-0101B.C
REFER EH2 DRAWINGS BELOW H31 GRID
9M WIDE FIRE TENDER PATH
SERVICES TRENCH
TRENCHES
FIRE COMPARTMENT
SLIDING FOLDING PARTITION
CABINET FOR SLIDING FOLDING PARTITION
HVAC CUTOUT
RWP WITH REMOVABLE ACCESS PANEL
100MM EXPANSION JOINT
INTERIOR CURTAIN
BRIDGE PROFILE
EXHIBITION HALL
EQUIPMENT DROP
MEDIA ROOM
EXECUTIVE LOUNGE
HOLDING AREA
FRISKING KIOSK FOR WOMEN
FRISKING AREA
SECURITY CHECK MAIN ACCESS TO EXHIBITION HALL
RAIN WATER DOWNTAKE SHAFT
SKYLIGHT AT ROOF LEVEL
EMERGENCY STOP @0.6 M LVL
EXHAUST AIR TOWER
FRESH AIR TOWER
THIRD FLOOR PROFILE
THIRD FLOOR PROFILE
THIRD FLOOR PROFILE